
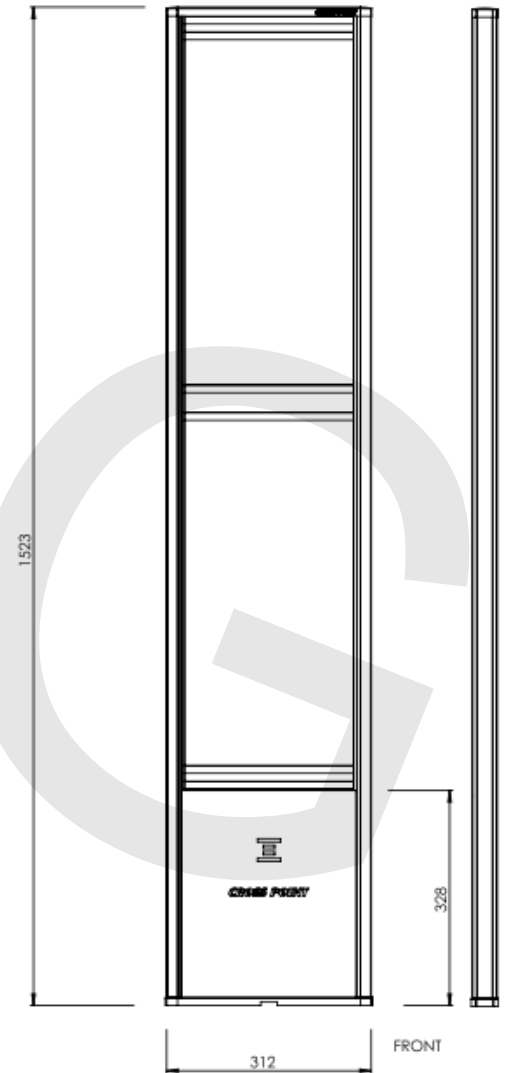



# Modus AM30 Nuda Single (Transceiver) System Requirements

# VITAG

Tel 1300 551 662  
Fax 1300 551 649  
Email [info@vitag.com.au](mailto:info@vitag.com.au)  
Website [www.vitag.com.au](http://www.vitag.com.au)

 Power Cable, Supplied

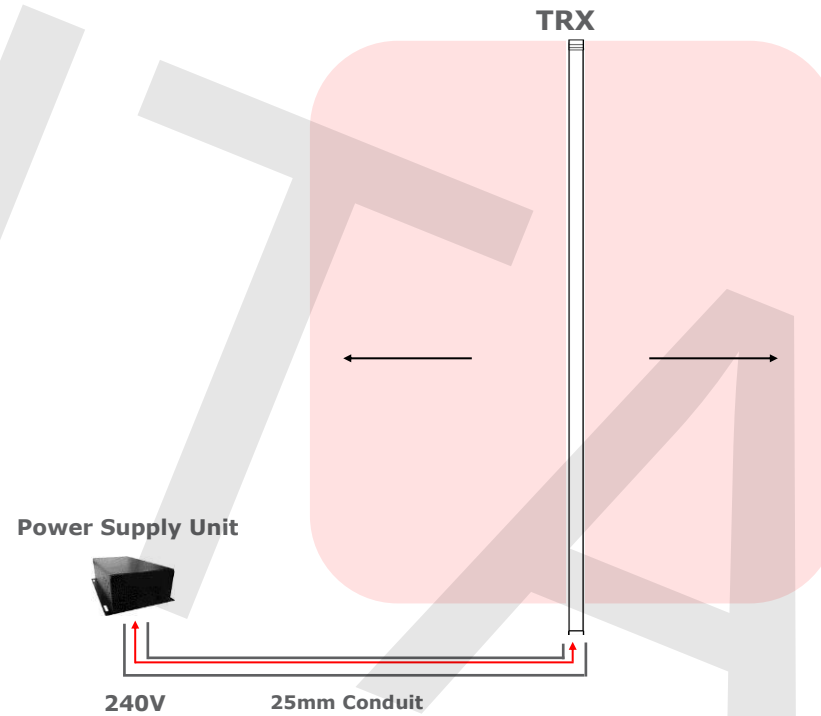

Modus AM30 Nuda Transceiver-PSU:

**CP2101-6423-5100**

Power Supply:

**210mm x 172mm x 70mm**

Detection zone is dependent on Tags/Labels to be used - refer to consultant

**Builder** - Provide single 25mm Conduit in floor chase from Power Supply to Pedestal.