


# iSense i45 - Single Transceiver with Internet Connection System Requirements

# VITAG

Tel 1300 551 662  
 Fax 1300 551 649  
 Email [info@vitag.com.au](mailto:info@vitag.com.au)  
 Website [www.vitag.com.au](http://www.vitag.com.au)

— Cat 5/6 Cable, Supplied by Technician

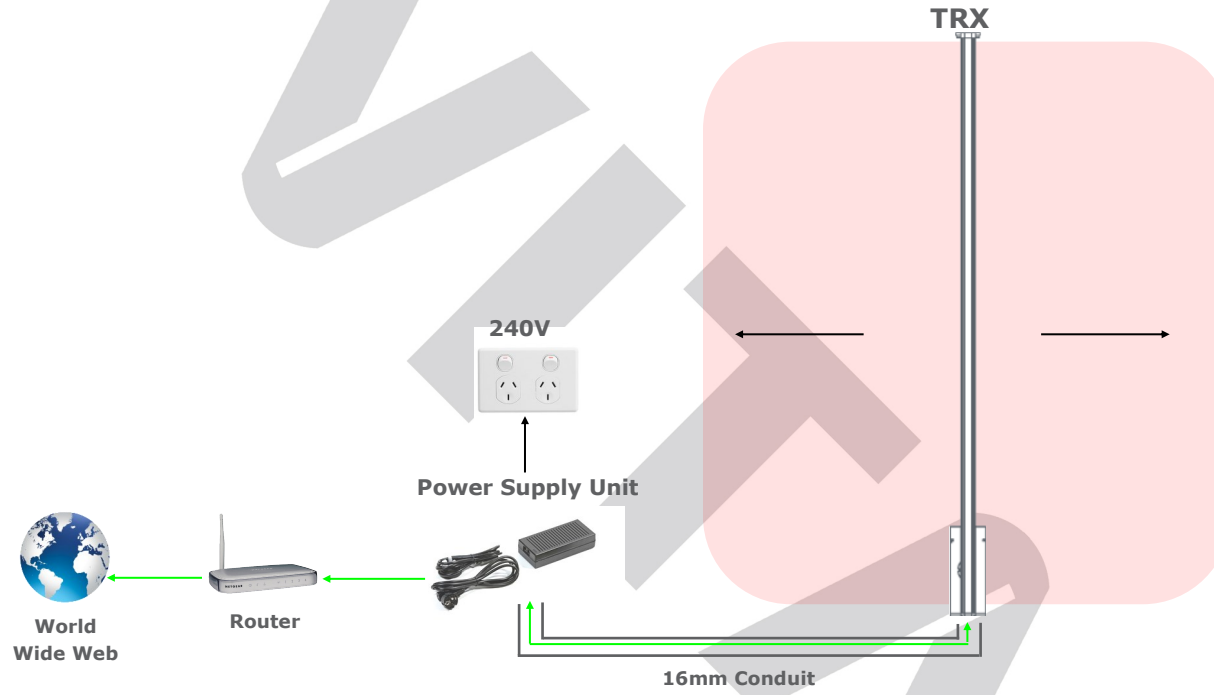

Up to 5 Pedestals may be added in same configuration

i45 RF iSense Pedestal - Grey

ND9563881

Power Inserter Renos (PoE)

ND9563067

Infrared Counting Sensor i45

ND8020701

Power Supply:

188mm x 84mm x 45mm

Detection zone is dependent on Tags/Labels to be used - refer to consultant

**Builder** - Provide single 16mm minimum Conduit in floor chase from Power Supply to last Pedestal with T pieces and sweeps at centre of each Pedestal. Alternative grout-line cuts or options for cabling around doorways should be discussed with Vitag.

