
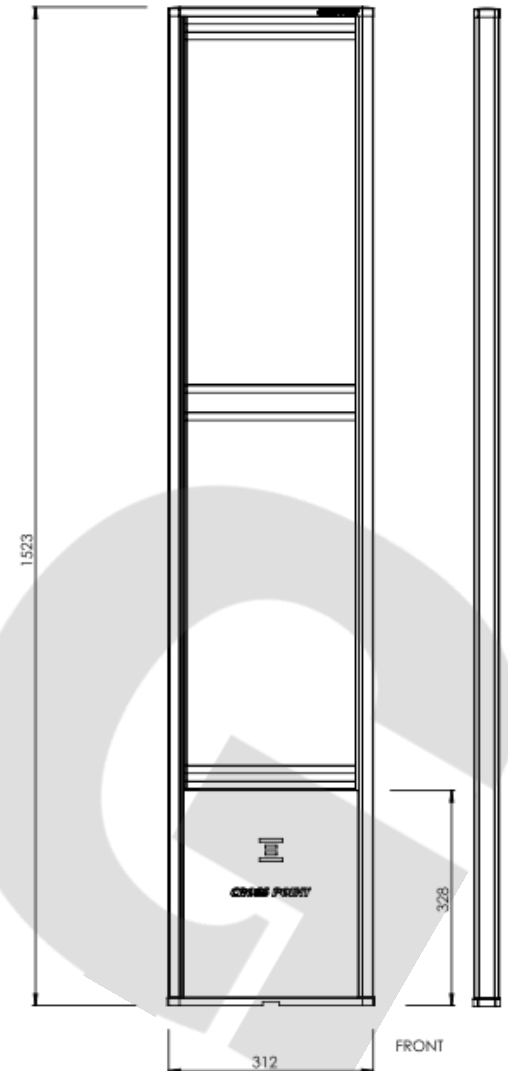



Modus AM30 Nuda Single (Transceiver) System Requirements

VITAG

Tel 1300 551 662
Fax 1300 551 649
Email info@vitag.com.au
Website www.vitag.com.au

Power Cable, Supplied

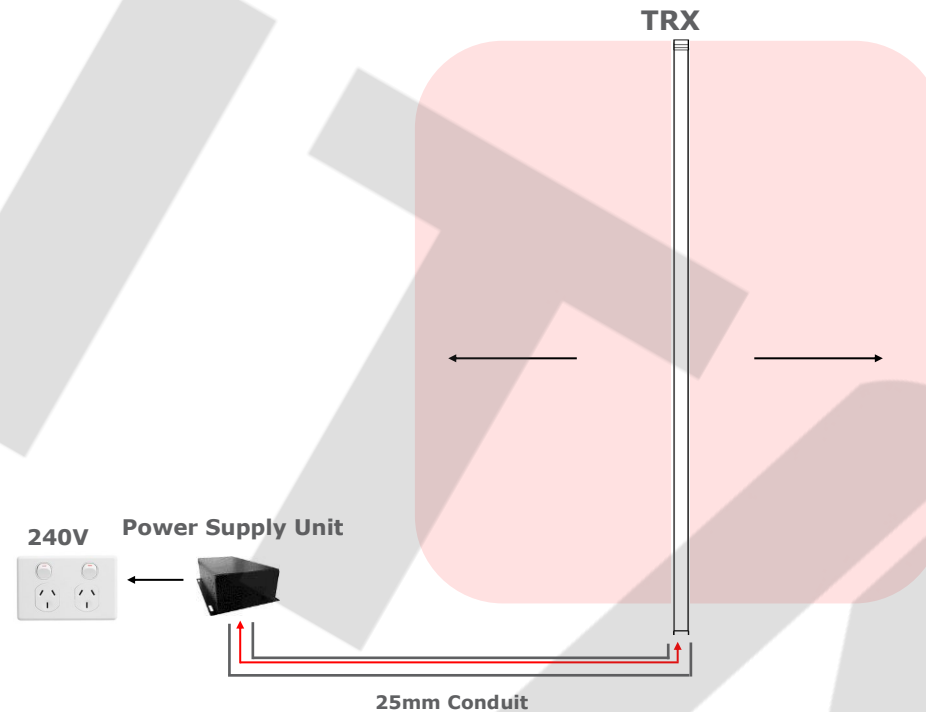

Modus AM30 Nuda Transceiver-PSU:

CP2101-6423-5100

Power Supply:

210mm x 172mm x 70mm

Detection zone is dependent on Tags/Labels to be used - refer to consultant

Builder - Provide single 25mm Conduit in floor chase from Power Supply to Pedestal.

Cable Spec: Power Cable = 3 CORE 7/0.30 SHIELDED CONTROL CABLE or equivalent, Slave Cable = Belden-M 8723 Multi-Conductor - Shielded Twisted Pair Cable or equivalent