


Nexus AM30 Optima Triple (3 x Transceiver) System Requirements


VITAG

Tel 1300 551 662
 Fax 1300 551 649
 Email info@vitag.com.au
 Website www.vitag.com.au

Power Cable, Supplied

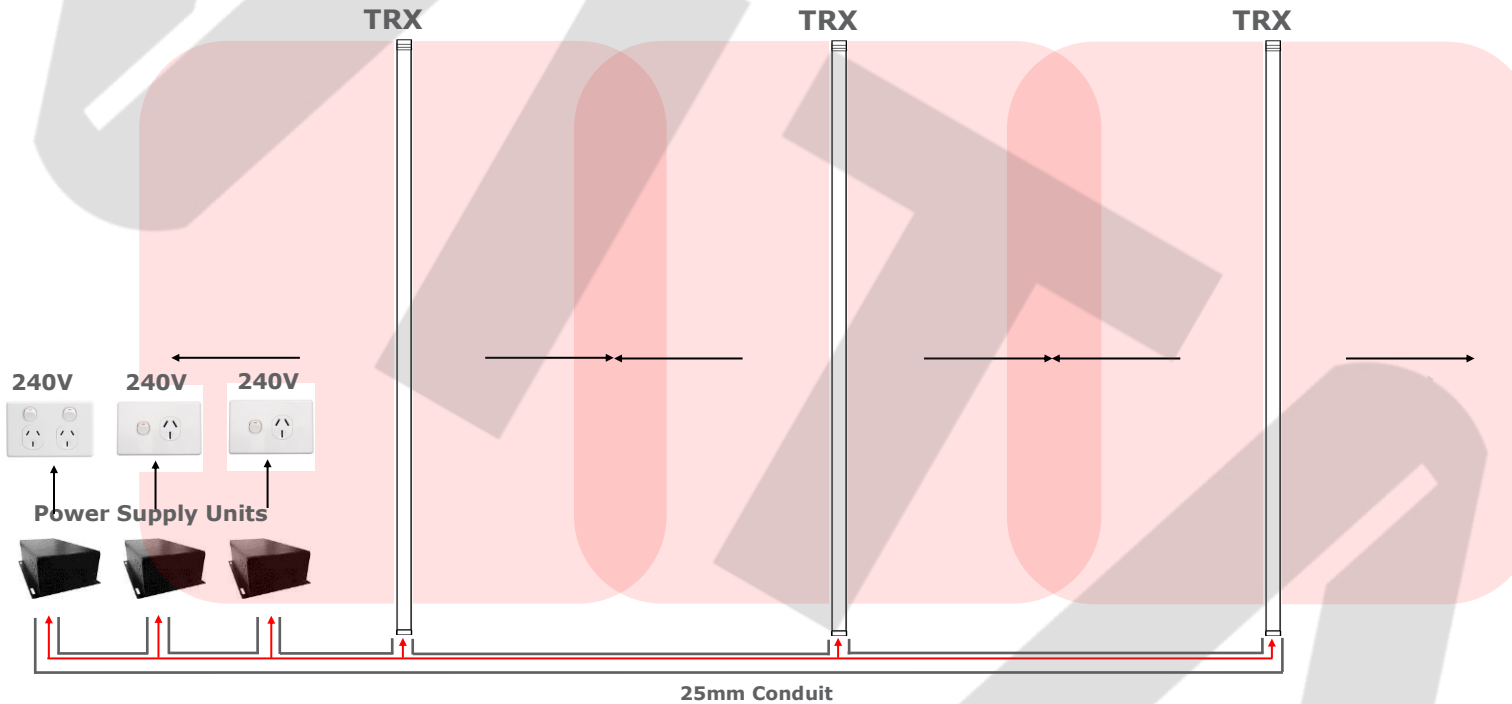

Additional Pedestals may be added in same configuration

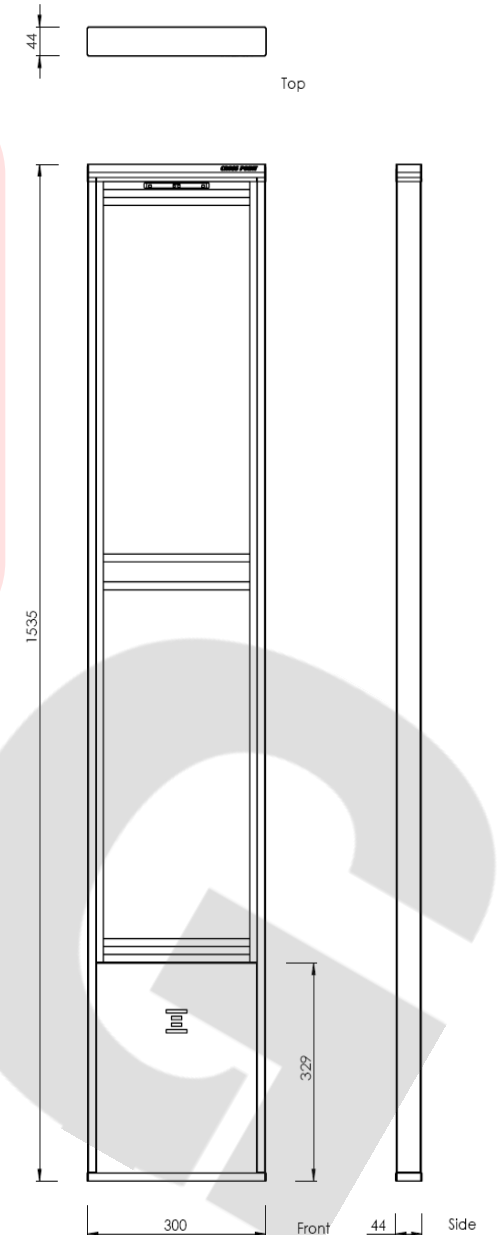

Nexus AM30 Optima Transceiver-PSU:

CP2101-7023-5300

Power Supply:

210mm x 172mm x 70mm

Pedestal spacing is dependent on Tags/Labels to be used - refer to consultant

Builder - Provide single 25mm Conduit in floor chase from Power Supply to each Pedestal with T pieces and/or sweeps at centre of each Pedestal. PSUs can be located separately.

Cable Spec: Power Cable = 3 CORE 7/0.30 SHIELDED CONTROL CABLE or equivalent, Slave Cable = Belden-M 8723 Multi-Conductor - Shielded Twisted Pair Cable or equivalent